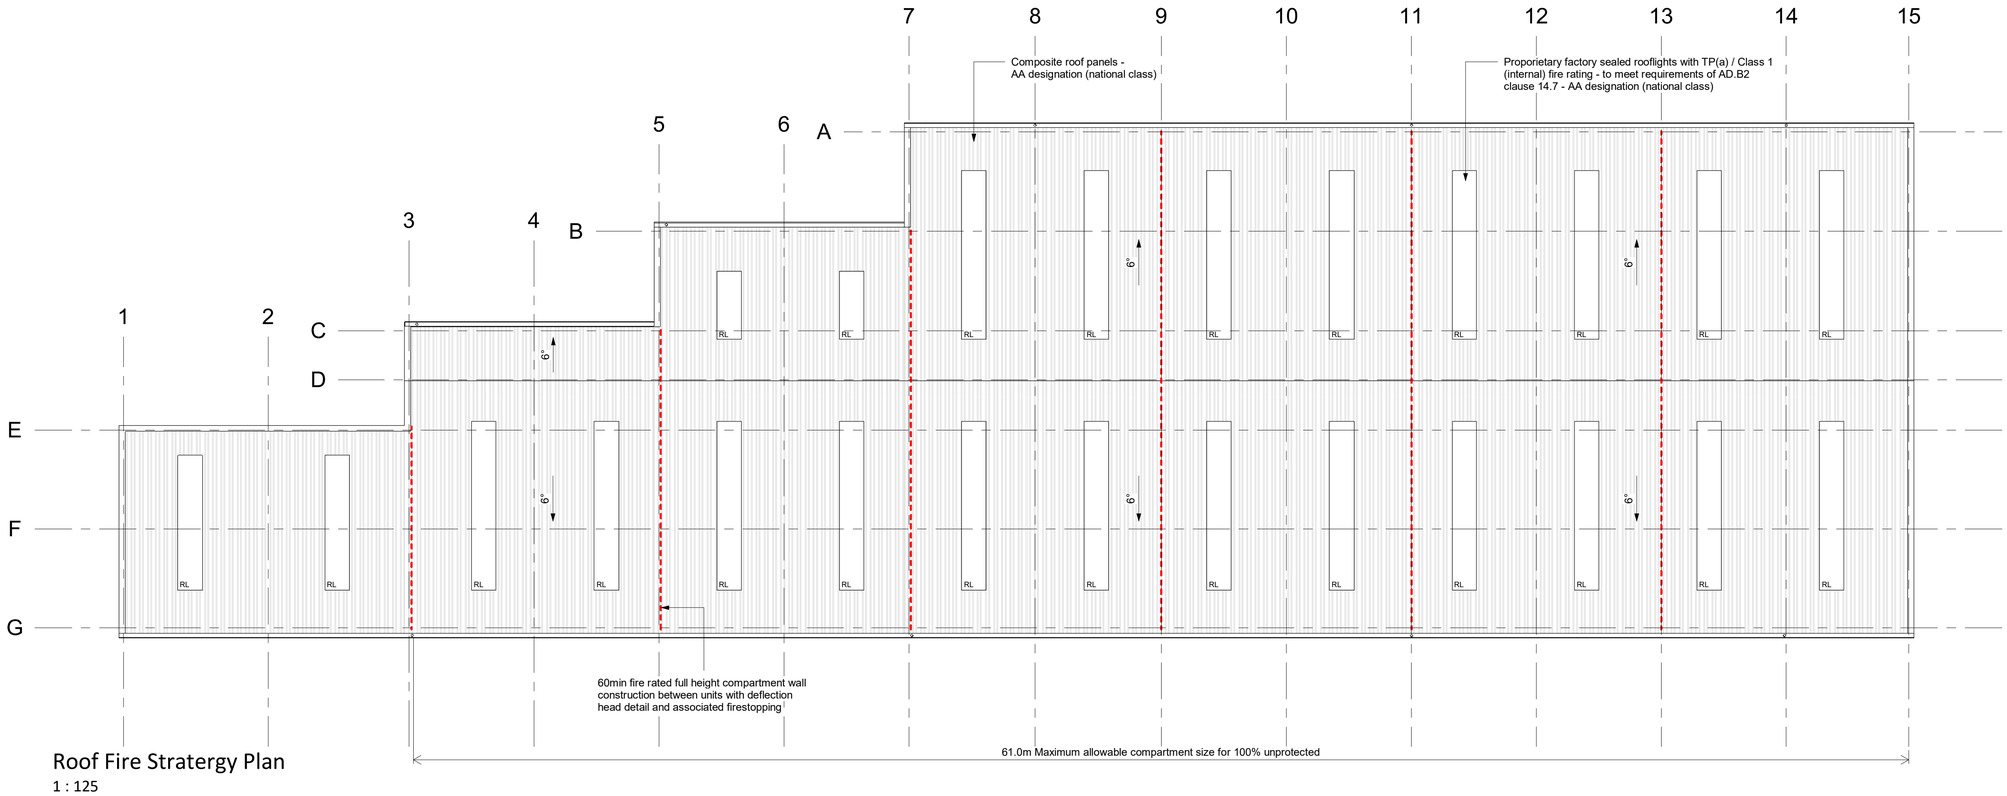

Roof Fire Stratergy Plan

1 : 125

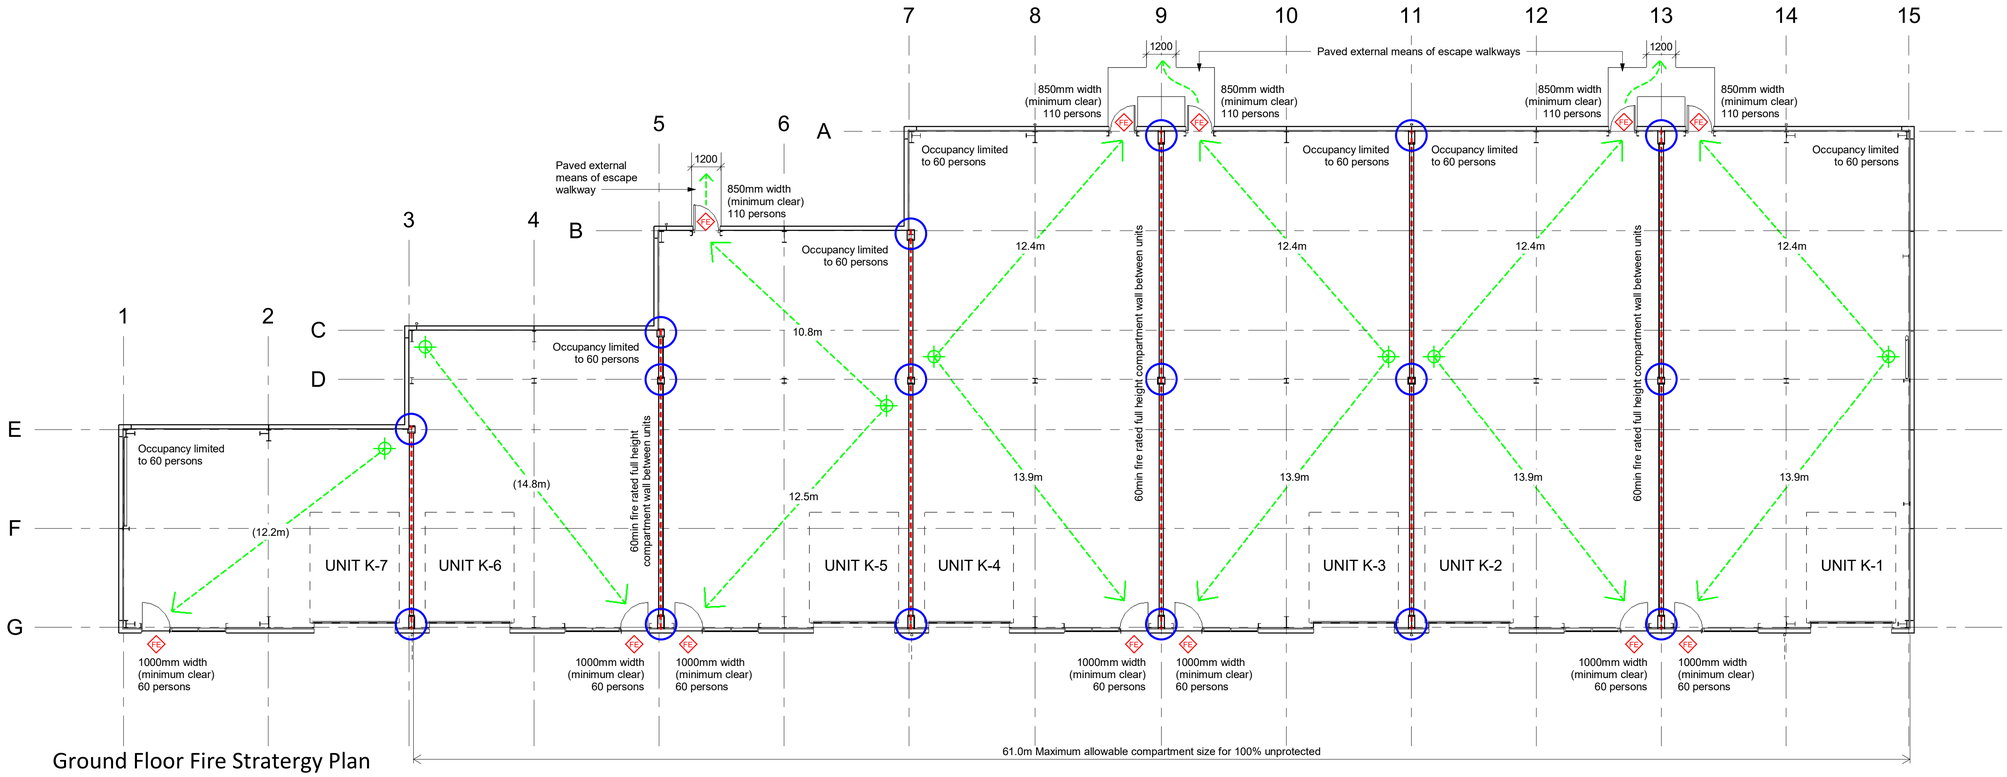

Ground Floor Fire Stratergy Plan

1 : 125

Notes

Scaled dimension are not to be used for construction

Contractor to check all dimensions and report omissions and errors to the Architect

Works are restricted to shell works under this contract - electrically installation including emergency lighting / fire alarm and detection (if installed) undertaken by tenant as part of their fitout contract

Single fire exit route only - limiting numbers to **60 max**.
Final exit width - limiting numbers to **60 max**.

- 60min fire rated structural columns and frame via a finished 3 / 4 sided Fireline board encasement system as part of compartment wall construction
- 60min fire rated intumescent coating - applied to all exposed faces - 60min fire rated board finishing to 50mm secondary framing zone
- 60min fire rated full height compartment wall construction between units with deflection head arrangement
- 60min fire rated external wall construction
- XX (XX) — Total travel distance (Distance in a single direction)
- FE — Final Exit

STATUS	REV	DATE	DESCRIPTION
S2	P5	06/08/2018	Original Issue

Forum Architecture Ltd
Studio S2, Basepoint
Andersons Road
Southampton, Hampshire
SO14 5FE

tel: 023 8068 2095

www.forumarchitecture.co.uk

CLIENT
Knights Brown Construction Ltd

PROJECT
Daedalus Park
Site B (North and South)

DRAWING TITLE
KEPPEL Fire Strategy - Ground Floor & Roof Arrangement

DRAWING STATUS	DWN BY	ORIGINATOR No.
S2 : SUITABLE FOR INFORMATION	JL	18013
	CHK BY: MGB	SCALE: As indicated@A1

PROJECT | ORIGINATOR | ZONE | LEVEL | TYPE | ROLE | CLASSIFICATION | NUMBER
DPSB-FORUM-KE-ZZ-DR-A-XX-2600

REVISION
P5